
750 KVA TRANSFORMER PAD



T.000 T.D.T.	
5,000 LB S	Concrete: 4000PSI @ 28 days
	Reinforcement: ASTM A615/A615M GRADE 60 ASTM A1064/A1064M-16B
	The tank is a monolithic pour (no mid seams). Top Slab is sealed with prostick mastic. The tank is designed to meet HS 20-44 loading requirements. Reinforced lid - has optional PA inspection port. Reinforced risers are available. Joutional inlets and I outlet location.

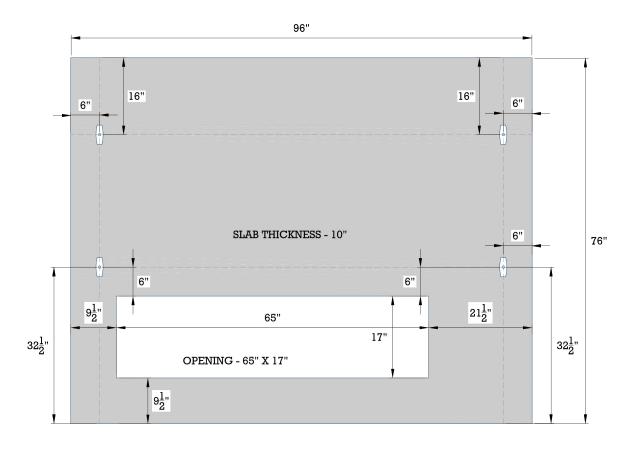

February 16, 2021 - 6:32am - JMI Transformer Switch Gear Pads 2021.dwg